

LIOB-151 I/O Module

Installation instructions

Instructions de montage







Montageanweisung



Montagevoorschrift

Istruzioni di montaggio

Instrucciones de montaje

Monteringsanvisning

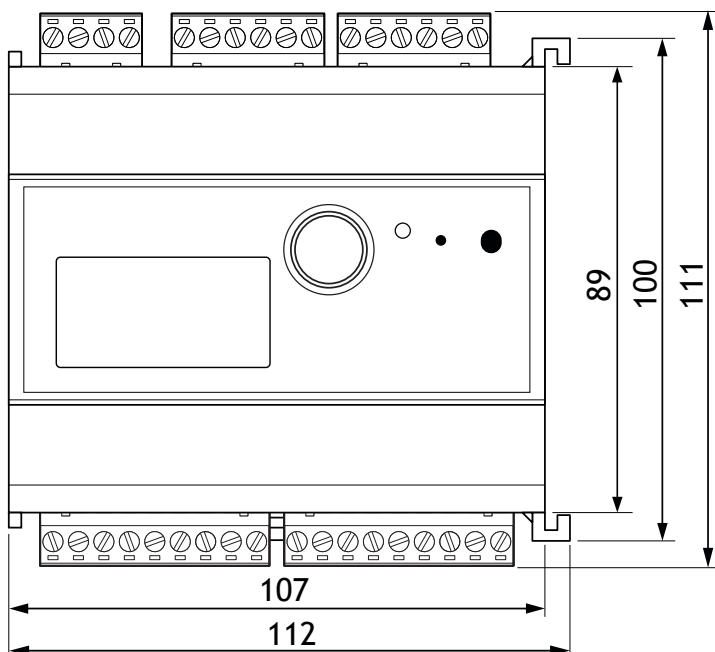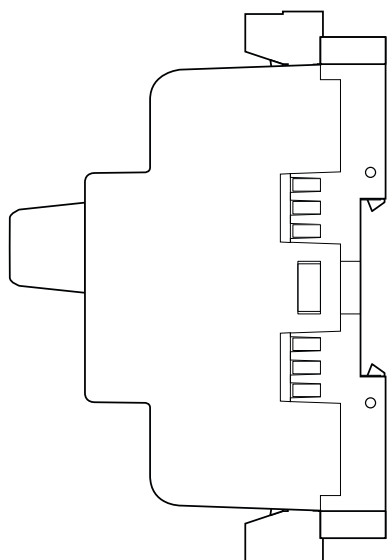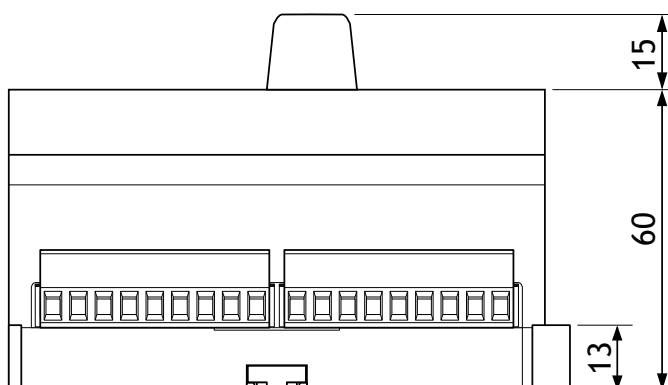

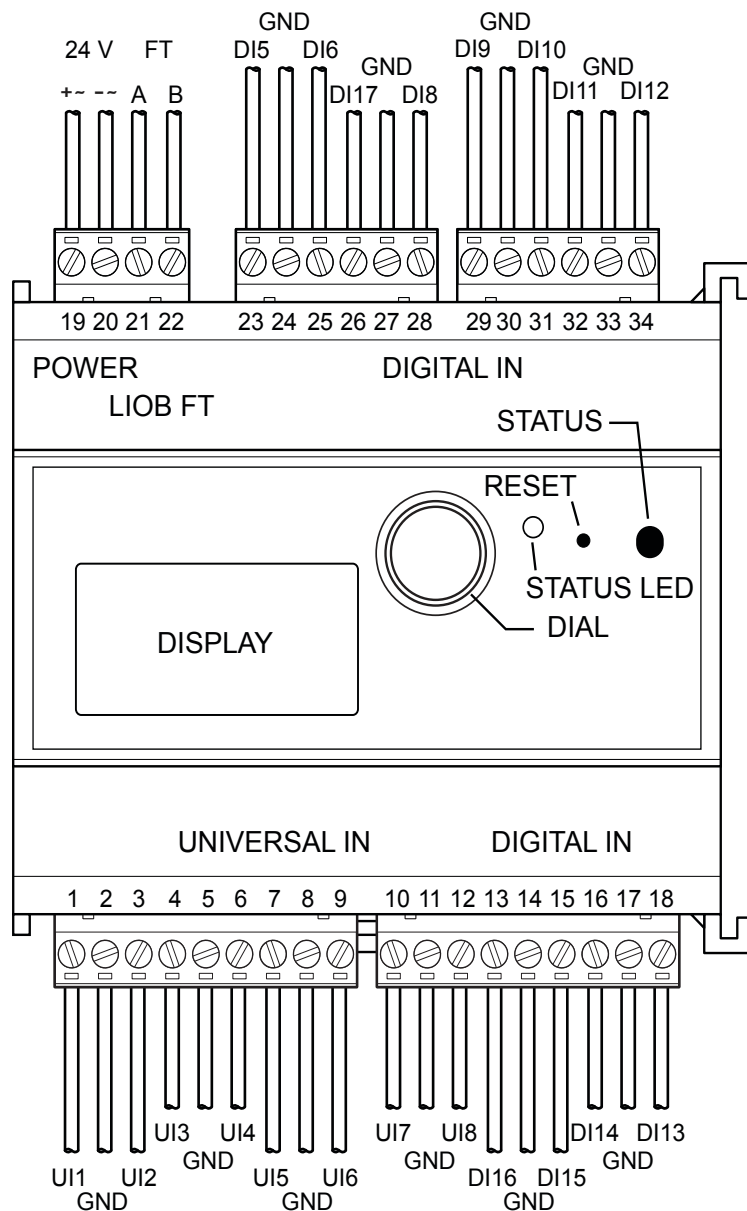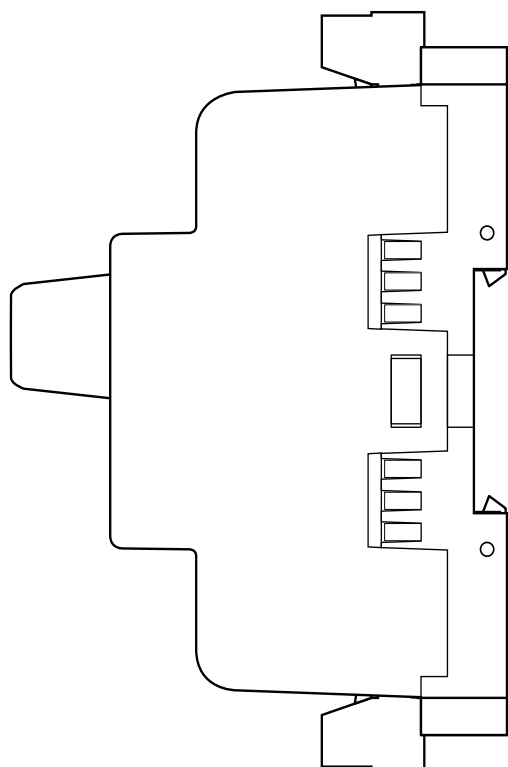


Buttons	
STATUS	Status Button
RESET	Reset Button
DIAL	Turn-and-Push Dial

Connectors		
UNIVERSAL INPUT	1	Input UI1
	2	Input GND
	3	Input UI2
	4	Input UI3
	5	Input GND
	6	Input UI4
	7	Input UI5
	8	Input GND
	9	Input UI6
	10	Input UI7
	11	Input GND
	12	Input UI8
DIGITAL INPUT	13	Input DI16
	14	Input GND
	15	Input DI15
	16	Input DI14
	17	Input GND
	18	Input DI13

Connectors		
POWER SUPPLY	19	Input 24 V PLUS or AC
	20	Input 24 V MINUS or AC ⚠ Do NOT ground Input 19 (+24V)
TP/FT-10	21	LIOB FT Input A
CEA-709	22	LIOB FT Input B
DIGITAL INPUT	23	Input DI5
	24	Input GND
	25	Input DI6
	26	Input DI7
	27	Input GND
	28	Input DI8
	29	Input DI9
	30	Input GND
	31	Input DI10
	32	Input DI11
	33	Input GND
	34	Input DI12

Status LED		
STATUS	OFF	Unconfigured
	GREEN	LIOB-151 in operation
	ORANGE	LIOB-151 in manual / overwrite mode
	RED	Error
	FLASHING	Traffic

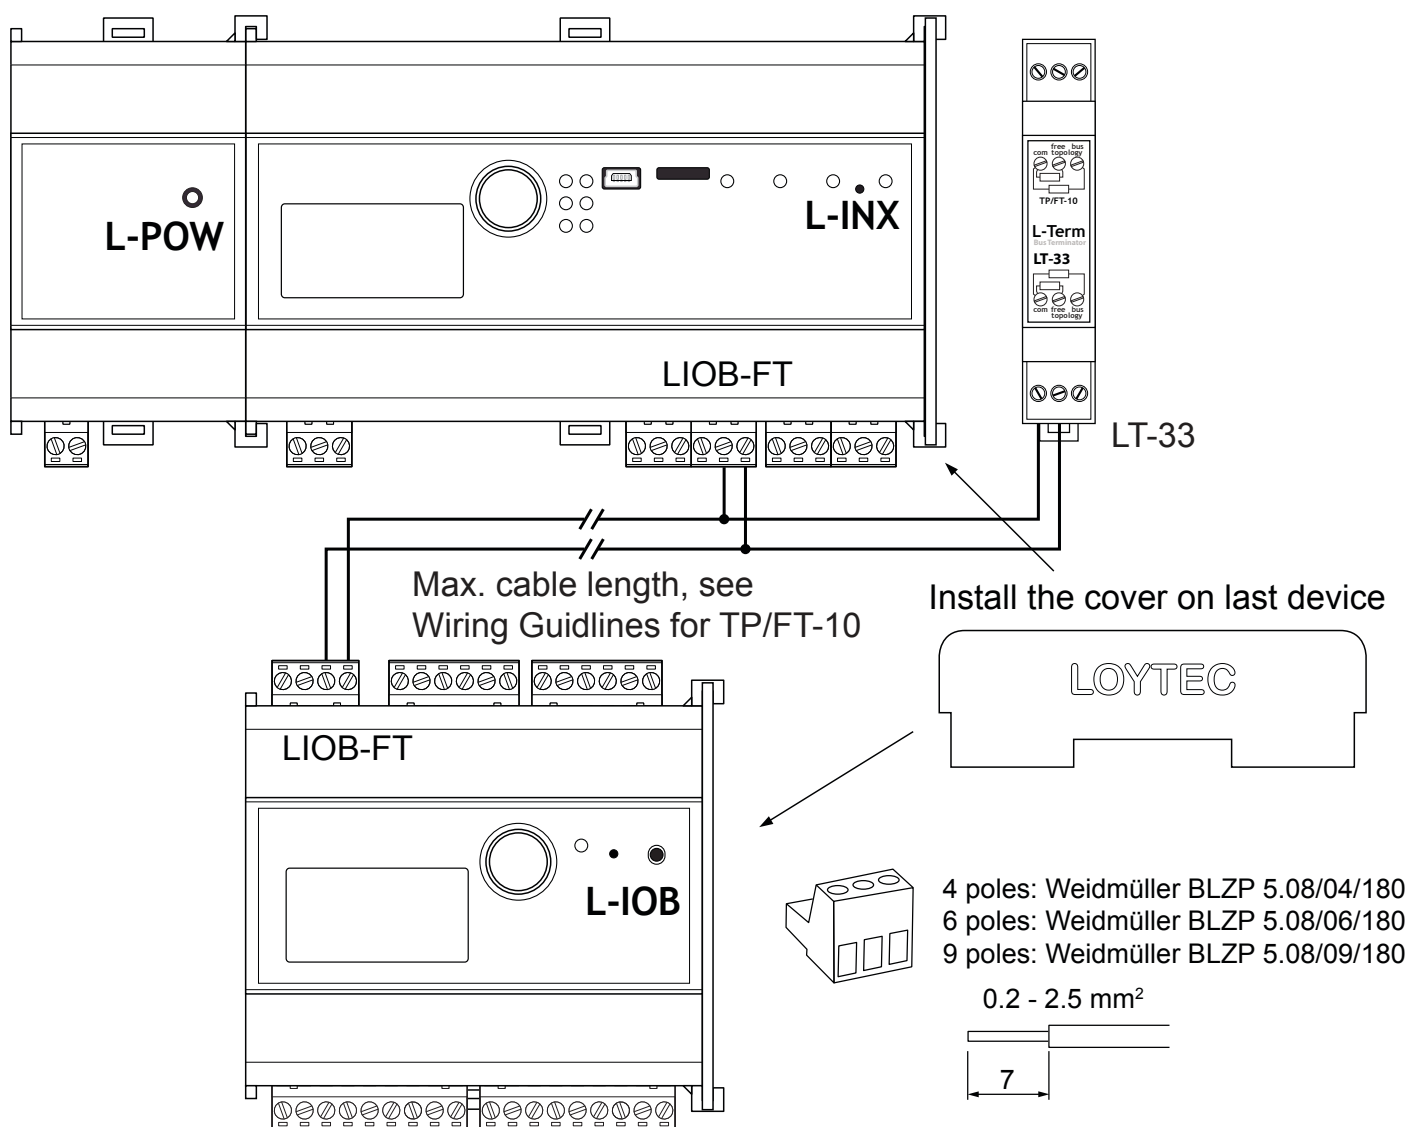

35 mm x 7.5 mm DIN rail (EN 50022, BS 5584, DIN 46277-3)

