

data

## SHEET



## BASremote — Versatile BACnet/IP Controller/Gateway

The BASremote series provide the system integrator a flexible building block when integrating diverse building automation protocols or when expanding the number of points in a building automation system. By supporting open system protocols such as BACnet®, Modbus and Sedona Framework™ SOX,

the BASremote series is easily adaptable. For small systems, it can operate stand-alone. For larger systems, it can communicate to supervisory controllers over Ethernet. Depending upon the model, the BASremote has the flexibility to provide the following:

### Versatile Control Device — remote I/O, router, gateway and controller

- Web-page configuration
- BACnet/IP remote I/O
- Modbus TCP remote I/O
- Modbus Serial to Modbus TCP router
- Modbus Serial or TCP to BACnet/IP gateway
- Modbus Master to Modbus TCP or serial slaves
- Certified Sedona Framework Controller®
- Power over Ethernet (PoE)
- Customisable webpages
- Web Services



### Flexible Input/Output — expandable with the addition of expansion I/O modules

- Six universal input/output points web-page configurable
- Two relay outputs
- Thermistor, voltage, current, contact closure and pulse inputs
- Voltage, current and relay outputs
- 2-wire Modbus Serial expansion bus
- Expansion port for up to three expansion I/O modules

**BASautomation**®

## BASremote Master – Versatile BACnet/IP Controller/Gateway

The BASremote Master provides the ultimate in flexibility. It can be used for expansion I/O at remote locations where an Ethernet connection exists. Its built-in router and gateway capabilities address unique integration needs where more than one communications protocol is involved. It can operate as a function block programmable controller with its resident Sedona Framework 1.2 virtual machine. Powered by a Linux engine, the BASremote Master can operate as BACnet/IP and Modbus TCP remote I/O, Sedona Framework controller, Modbus Serial to Modbus TCP router, Modbus Serial to BACnet gateway, and Modbus master to attached Modbus slaves all at the same time. A 10/100 Mbps Ethernet port allows connection to IP networks and popular building automation protocols such as Modbus TCP, BACnet/IP, and Sedona SOX. Six universal I/O points and two relay outputs can be configured through resident web pages using a standard web browser and without the need of

a special programming tool. A 2-wire Modbus serial port can greatly expand the I/O count with built-in routing to Modbus TCP clients. If BACnet mapping is preferred, the unit incorporates a Modbus serial to BACnet/IP gateway — capable of processing up to 1000 points. The BASremote Master also allows you to install custom web pages so you can view the status of your system in a convenient manner. And using its onboard Web Services, your IT department can easily interact with the BASremote Master.

Additional universal I/O can be achieved with the simple addition of BASremote Expansion modules. The BASremote PoE has the same capabilities as the BASremote Master except that it is powered over the Ethernet connection — thereby providing a “One Cable Solution”.

### Universal I/O

Using web pages, six points can be configured as either inputs or outputs, analog or digital. In addition to being discoverable as BACnet objects, these same points can be assigned Modbus addresses.

- Analog inputs: 0–10 VDC, 0–20 mA but scalable to 0–5 VDC and 4–20 mA
- Temperature inputs: Type II or Type III thermistors
- Contact closure or Pulse inputs: Free-voltage, 40 Hz maximum
- Analog outputs: 0–10 VDC, 0–20 mA

All field connectors are removable.

### Auxiliary Power Output

24 VDC @ 150 mA for powering field devices such as 4–20 mA transmitters.

### Ethernet

10/100 Mbps Ethernet with auto-negotiation and Auto-MDIX. Protocols supported include HTTP, IP, UDP, TCP, SOAP, BACnet/IP, Modbus TCP, and Sedona SOX.

### Power Input

24 VAC/VDC 17 VA half-wave regulated allows power sharing with other half-wave devices.

### Modbus Serial Bus


RTU or ASCII master, 2.4–115.2 kbps, 2-wire non-isolated, up to 31 full-load EIA-485 devices

### Expansion Port

Proprietary bus supporting up to three expansion modules requiring no configuration.

### Relay Outputs

Two form “C” contacts for 30 VAC/VDC 2 A loads. Class 2 circuits only.

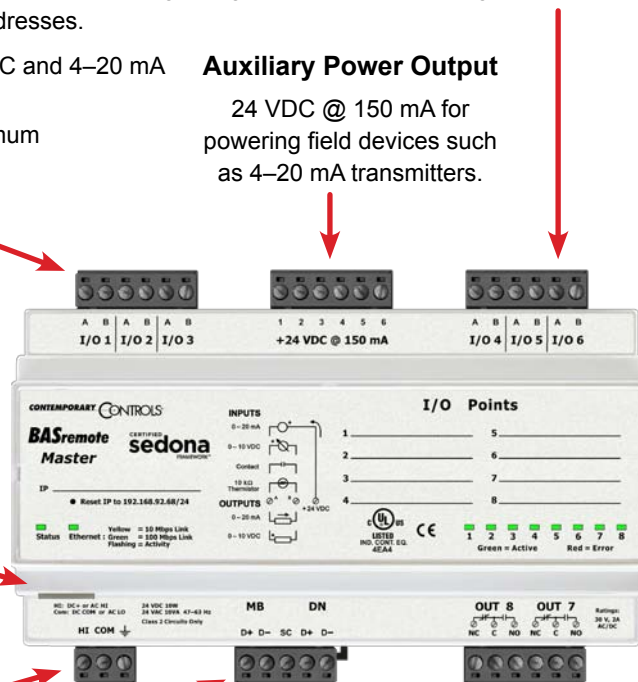

## Some Common Components Used In Function Block Programming

<p><b>The HVAC Group</b> operations that facilitate control</p>	<p><b>LSeq</b> <b>ReheatSeq</b> <b>Reset</b> <b>Tstat</b></p>	<p>Linear Sequencer — bar graph representation of input value Reheat sequence — linear sequence up to four outputs Reset — output scales an input range between two limits Thermostat — on/off temperature controller</p>
<p><b>The Scheduling Group</b> scheduling operations based upon time of day</p>	<p><b>DailySc</b> <b>DailyS1</b> <b>DateTime</b></p>	<p>Daily Schedule Boolean — two-period Boolean scheduler Daily Schedule Float — two-period float scheduler Time of Day — time, day, month, year</p>
<p><b>The Function Group</b> convenient functions for developing control schemes</p>	<p><b>Cmpr</b> <b>Count</b> <b>Freq</b> <b>Hysteresis</b> <b>IRamp</b> <b>Limiter</b> <b>Linearize</b> <b>LP</b> <b>Ramp</b> <b>SRLatch</b> <b>TickTock</b> <b>UpDn</b></p>	<p>Comparison math — comparison (&lt;=&gt;) of two floats Integer counter — up/down counter with integer output Pulse frequency — calculates the input pulse frequency Hysteresis — setting on/off trip points to an input variable IRamp — generates a repeating triangular wave with an integer output Limiter — Restricts output within upper and lower bounds Linearize — piecewise linearization of a float LP — proportional, integral, derivative (PID) loop controller Ramp — generates a repeating triangular or sawtooth wave with a float output Set/Reset Latch — single-bit data storage Ticking clock — an astable oscillator used as a time base Float counter — up/down counter with float output</p>
<p><b>The Priority Group</b> prioritizing actions of Boolean, Float and Integer variables</p>	<p><b>PrioritizedBool</b> <b>PrioritizedFloat</b> <b>PrioritizedInt</b></p>	<p>Prioritized boolean output — highest of sixteen inputs Prioritized float output — highest of sixteen inputs Prioritized integer output — highest of sixteen inputs</p>
<p><b>The Types Group</b> variable types and conversion between types</p>	<p><b>B2F</b> <b>ConstBool</b> <b>ConstFloat</b> <b>ConstInt</b> <b>F2B</b> <b>F2I</b> <b>I2F</b> <b>WriteBool</b> <b>WriteFloat</b> <b>WriteInt</b></p>	<p>Binary to float encoder — 16-bit binary to float conversion Boolean constant — a predefined Boolean value Float constant — a predefined float variable Integer constant — a predefined integer variable Float to binary decoder — float to 16-bit binary conversion Float to integer — float to integer conversion Integer to float — integer to float conversion Write Boolean — setting a writable Boolean value Write Float — setting a writable float value Write integer — setting an integer value</p>
<p><b>The Logic Group</b> logical operations using Boolean variables</p>	<p><b>ADemux2</b> <b>And2</b> <b>ASW</b> <b>ASW4</b> <b>And4</b> <b>B2P</b> <b>BSW</b> <b>DemuxI2B4</b> <b>ISW</b> <b>Or2</b> <b>Or4</b> <b>Not</b> <b>Xor</b></p>	<p>Analog Demux — Single-input, two-output analog de-multiplexer Two-input Boolean product — two-input AND gate Analog switch — selection between two float variables Analog switch — selection between four floats Four-input Boolean product — four-input AND gate Binary to pulse — simple mono-stable oscillator (single-shot) Boolean switch — selection between two Boolean variables Four-output Demux — integer to Boolean de-multiplexer Integer switch — selection between two integer variables Two-input Boolean sum — two-input OR gate Four-input Boolean sum — four-input OR gate Not — inverts the state of a Boolean Two-input exclusive Boolean sum — two-input XOR gate</p>
<p><b>The Timing Group</b> extended Boolean logic</p>	<p><b>DlyOff</b> <b>DlyOn</b> <b>OneShot</b> <b>Timer</b></p>	<p>Off delay timer — time delay from a “true” to “false” transition of the input On delay timer — time delay from an “false” to “true” transition of the input Single Shot — provides an adjustable pulse width to an input transition Timer — countdown timer</p>
<p><b>The Math Group</b> operations on Float, Integer and Boolean variables</p>	<p><b>Add2</b> <b>Add4</b> <b>Avg10</b> <b>AvgN</b> <b>Div2</b> <b>FloatOffset</b> <b>Max</b> <b>Min</b> <b>MinMax</b> <b>Mul2</b> <b>Mul4</b> <b>Neg</b> <b>Round</b> <b>Sub2</b> <b>Sub4</b> <b>TimeAvg</b></p>	<p>Two-input addition — results in the addition of two floats Four-input addition — results in the addition of four floats Average of 10 — sums the last ten floats while dividing by ten thereby providing a running average Average of N — sums the last N floats while dividing by N thereby providing a running average Divide two — results in the division of two float variables Float offset — float shifted by a fixed amount Maximum selector — selects the greater of two inputs Minimum selector — selects the lesser of two inputs Min/Max detector — records both the maximum and minimum values of a float Multiply two — results in the multiplication of two floats Multiply four — results in the multiplication of four floats Negate — changes the sign of a float Round — rounds a float to the nearest N places Subtract two — results in the subtraction of two floats Subtract four — results in the subtraction of four floats Time average — average value of float over time</p>

# Web Page Configuration

## Web Server Screen

The screenshot displays the 'BAS Remote Web Configuration' interface. At the top, there are tabs for 'Main Unit', 'Expansion Unit 1', 'Expansion Unit 2', and 'Expansion Unit 3'. The 'Main Unit' tab is active. The interface is divided into two main sections: 'Remote Configuration' and 'Current Settings'.

**Remote Configuration:** This section shows a graphical representation of the BAS Remote Master unit. It features a central panel with 'I/O 1' through 'I/O 6' labels and a 'Map' button. To the right, there is a 'Key' section with 'C' for Configure and 'F' for Force. Below the key, there is a 'Main Unit' link and buttons for 'Modbus Utility' and 'Set Time'.

**Current Settings:** This section displays configuration details for the selected unit. It includes fields for 'Unit Name' (Master Unit), 'Modbus Address' (1), and 'Bacnet Device Instance' (2431). Below this, there are four channels listed with their respective settings:

Channel	Channel Name	Present Value
1	Analog Output	5.25 V
2	Analog Output	7.5 V
3	Binary Input	ON
4	10K Type3 THM	76.1 deg F

The 'Current Settings' section for channel 4 is expanded, showing the following configuration:

- Channel Type: INPUT: 0-20mA
- Channel Name: Prod Floor Temp
- BACNet Unit Group: Temperature
- BACNet Unit Value: DEGREES\_FAHRENH...
- BACNet COV Increment: 0
- BACNet Description: (empty field)

The 'User Scaling' section for channel 4 is also visible, showing a table with 'HIGH' and 'LOW' values for 'ACTUAL' and 'SCALED' values.

VALUE	ACTUAL	SCALED
HIGH	20	92
LOW	4	32

At the bottom of the expanded settings, there are 'SAVE' and 'CANCEL' buttons.


Typical I/O Point Configuration Screen

## Powered by Sedona Framework for Implementing Control

The BASremote Master incorporates Sedona Virtual Machine (SVM) technology developed by Tridium and compatible with their Niagara Framework™. Using established Tridium tools such as Niagara Workbench or Sedona Workbench, a system integrator can develop a control application using Workbench’s powerful drag-and-drop visual programming methodology. Once

developed, the program remains stored in the BASremote Master and executes by way of the SVM. The application can run standalone in the BASremote Master or interact with a program in a Tridium JACE supervisory controller over Ethernet. The number of potential applications is only limited by the imagination of the system integrator.

**Tridium’s Sedona Workbench or Niagara Workbench can be used to program Sedona running in the BAS Remote.**

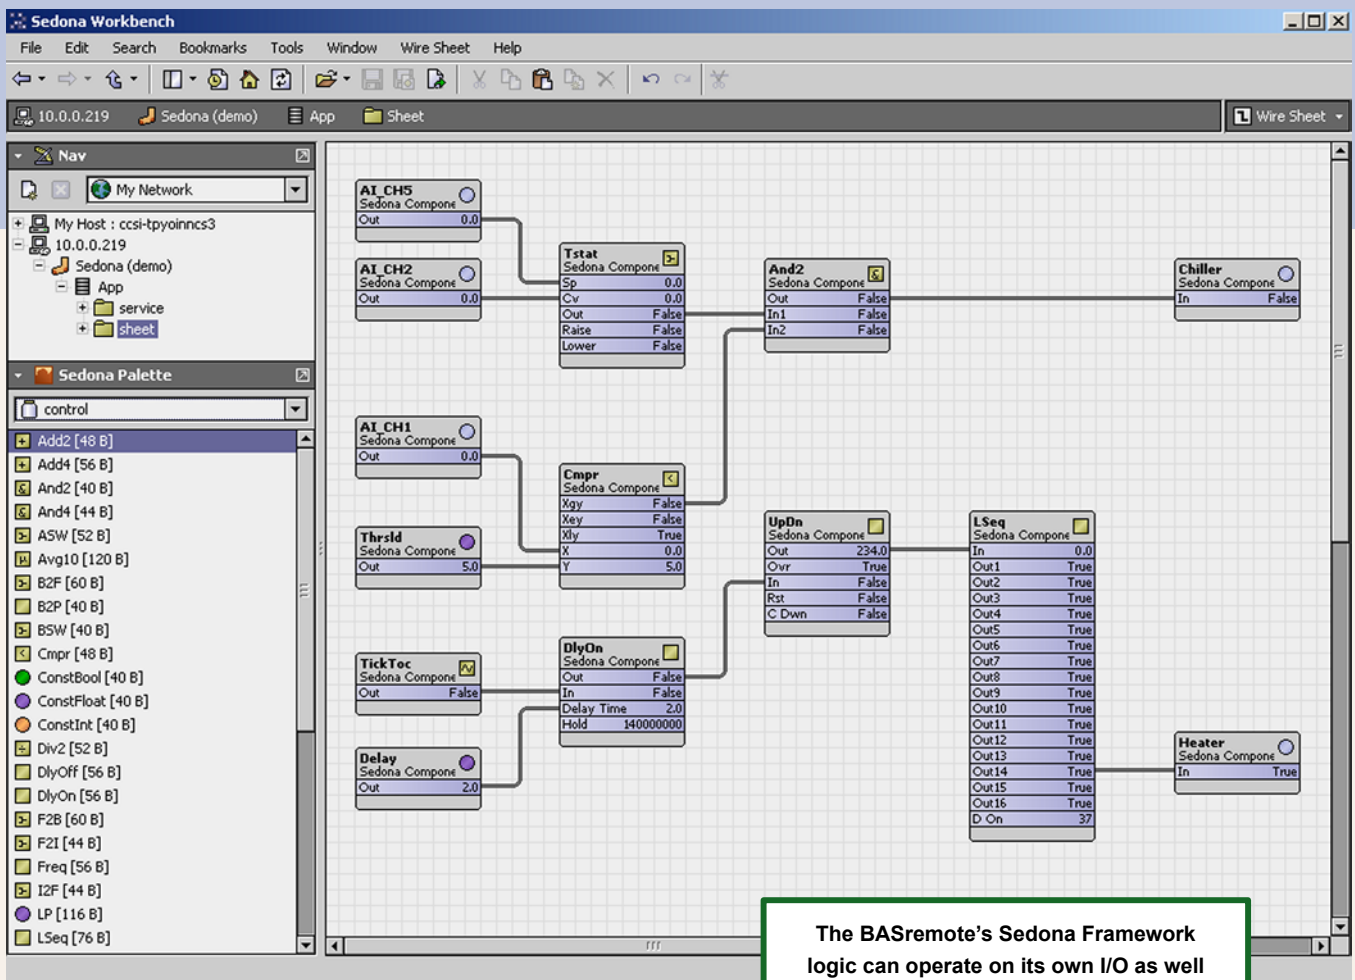

The BASremote’s Sedona Framework logic can operate on its own I/O as well as that of connected Modbus Serial or TCP devices. Also, a network connected Niagara Framework device can read or modify the operating state of the Sedona Framework function blocks.



# BACnet Protocol Implementation Conformance (PIC) Statement



## BASremote

Versatile BACnet/IP Controller/Gateway



### BACnet Protocol Implementation Conformance Statement (Annex A)

**Date:** August 12, 2013  
**Vendor Name:** Contemporary Controls  
**Product Name:** BASremote  
**Product Model Number:** BASR-8M  
**Applications Software Version:** 3.5.6    **Firmware Revision:** 3.5.6    **BACnet Protocol Revision:** 2  
**Product Description:** BACnet/IP compliant 8-point Sedona Framework controller with Modbus Gateway.

**BACnet Standardized Device Profile (Annex L):**

- BACnet Operator Workstation (B-OWS)
- BACnet Advanced Operator Workstation (B-AWS)
- BACnet Operator Display (B-OD)
- BACnet Building Controller (B-BC)
- BACnet Advanced Application Controller (B-AAC)
- BACnet Application Specific Controller (B-ASC)
- BACnet Smart Sensor (B-SS)
- BACnet Smart Actuator (B-SA)

**List all BACnet Interoperability Building Block Supported (Annex K):**

- DS-RP-B Data Sharing — ReadProperty – B
- DS-WP-B Data Sharing — WriteProperty – B
- DS-RPM-B Data Sharing — ReadPropertyMultiple – B
- DS-COV-B Data Sharing — ChangeOfValue – B
- DM-DDB-B Device Management — Dynamic Device Binding – B
- DM-DOB-B Device Management — Dynamic Object Binding – B
- DM-DCC-B Device Management — Device Communication Control – B
- DM-TS-B Device Management — Time Synchronization – B

**Segmentation Capability:**

- Able to transmit segmented messages    Window Size:
- Able to receive segmented messages    Window Size:

**Standard Object Types Supported:**

Object Type Supported	Can Be Created Dynamically	Can Be Deleted Dynamically
Analog Input	No	No
Analog Output	No	No
Analog Value	No	No
Binary Input	No	No
Binary Output	No	No
Device	No	No

No optional properties are supported.

**Data Link Layer Options:**

- BACnet IP, (Annex J)
- BACnet IP, (Annex J), Foreign Device
- ISO 8802-3, Ethernet (Clause 7)
- ATA 878.1, 2.5 Mb. ARCNET (Clause 8)
- ATA 878.1, EIA-485 ARCNET (Clause 8), baud rate(s):
- MS/TP master (Clause 9), baud rate(s):
- MS/TP slave (Clause 9), baud rate(s):
- Point-To-Point, EIA 232 (Clause 10), baud rate(s):
- Point-To-Point, modem, (Clause 10), baud rate(s):
- LonTalk, (Clause 11), medium:
- BACnet/Zigbee (Annex O)
- Other:

**Device Address Binding:**

Is static device binding supported? (This is currently necessary for two-way communication with MS/TP slaves and certain other devices.)  Yes     No

**Networking Options:**

- Router, Clause 6 – List all routing configurations, e.g., ARCNET-Ethernet-MS/TP, etc.
- Annex H, BACnet Tunnelling Router over IP
- BACnet/IP Broadcast Management Device (BBMD)
  - Does the BBMD support registrations by Foreign Devices?  Yes  No
  - Does the BBMD support network address translation?  Yes  No

**Character Sets Supported:**

Indicating support for multiple character sets does not imply that they can all be supported simultaneously.

- ISO 10646 (UTF-8)
- IBM™/Microsoft™ DBCS
- ISO 8859-1
- ISO 10646 (UCS-2)
- ISO 10646 (UCS-4)
- JIS X 0208

If this product is a communication gateway, describe the types of non-BACnet equipment/network(s) that the gateway supports:  
 Modbus gateway support.


**Network Security Options:**

- Non-secure Device — is capable of operating without BACnet Network Security
- Secure Device — is capable of using BACnet Network Security (NS-SD BIBB)
- Key Server (NS-KS BIBB)


August 12, 2013

TD040301-0XE

# Wiring Diagram

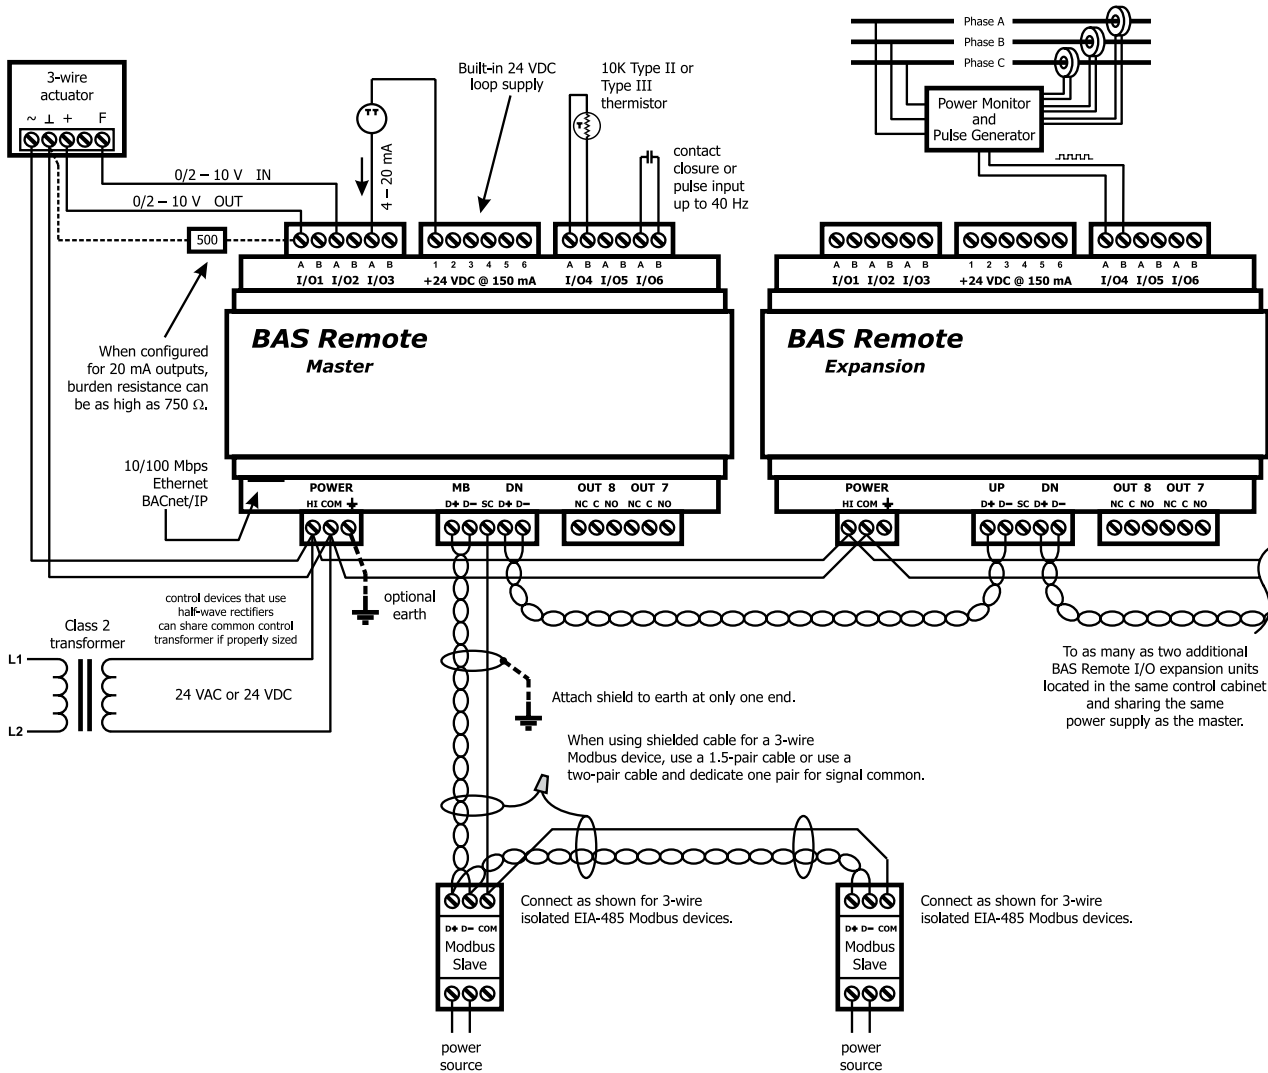

# Dimensions (for all models)

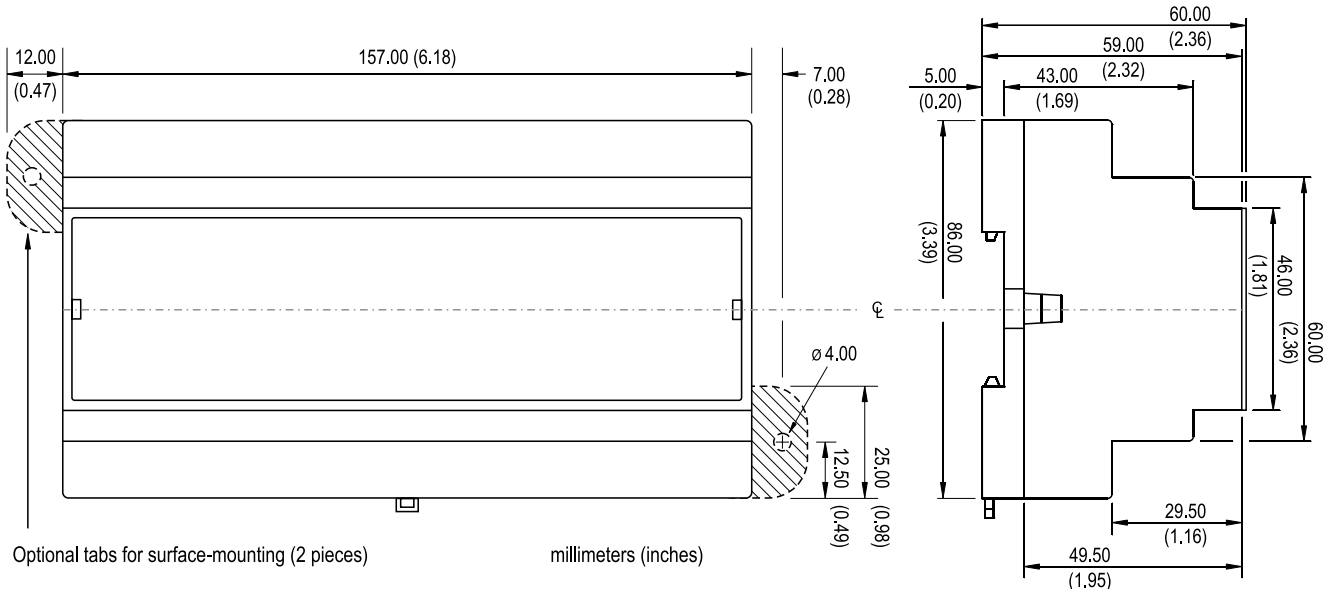

## Specifications

### Universal Inputs/Outputs (Channels 1–6)

<b>Configured As</b>	<b>Characteristics</b>
Analog input	0–10 VDC or 0–20 mA scalable by user. 10-bit resolution. Input impedance 100 kΩ on voltage and 250 Ω on current.
Temperature input	Type II or type III thermistors +40°F to +110°F (+4.4°C to +44°C)
Contact closure input	Excitation current 2 mA. Open circuit voltage 24 VDC. Sensing threshold 0.3 VDC. Response time 20 ms.
Pulse input	0–10 VDC scalable by user. User adjustable threshold. 40 Hz maximum input frequency with 50% duty cycle.
Analog output	0–10 VDC or 0–20 mA scalable by user. 12-bit resolution. Maximum burden 750 Ohms when using current output.

### Relay Outputs (Channels 7 and 8)

Form “C” contact with both NO and NC contacts. 30 VAC/VDC 2 A. Class 2 circuits only.

### Regulatory Compliance

CE Mark; CFR 47, Part 15 Class A; RoHS; UL 508, C22.2 No. 142-M1987



### Functional

### Ethernet

### Modbus Serial

	(BAS Remote Master Only)	
Compliance	IEEE 802.3	V1.02
Protocols supported	Modbus TCP BACnet/IP SOX	RTU master ASCII master
Data rate	10 Mbps, 100 Mbps	2.4 to 115.2 kbps
Physical layer	10BASE-T, 100BASE-TX	EIA-485, 2-wire, non-isolated
Cable length	100 m (max)	100 m (max)
Port connector	Shielded RJ-45	3-pin terminal
LEDs	Green = 100 Mbps Yellow = 10 Mbps Flash = activity	Status green flashing = Modbus active
Flow control	Half-duplex (backpressure)	

### Electrical

### Master

### Expansion

### Master/PoE

Input (DC or AC)	DC	AC	DC	AC	DC
Voltage (V, ± 10%)	24	24	24	24	48
Power	10 W	17 VA	8 W	17 VA	10 W
Frequency	N/A	47–63 Hz	N/A	47–63 Hz	N/A
Loop supply (24 VDC nom.)	150 mA (max)		150 mA (max)		150 mA (max)

### Environmental/Mechanical

Operating temperature	0°C to 60°C
Storage temperature	–40°C to +85°C
Relative humidity	10–95%, noncondensing
Protection	IP30
Weight	0.6 lbs. (.27 kg)



## Specifications (continued)

### RJ-45 Pin Assignments

MDI 10BASE-T/100BASE-TX

Terminal	Usage
1	TD +
2	TD –
3	RD +
6	RD –
Other pins	Not Used

### Modbus (MB) Pin Assignments

Terminal	Usage
D +	Data +
D –	Data –
SC	Signal Common

### Expansion Port (DN/UP) Pin Assignments

Terminal	Usage
D +	Data +
D –	Data –

## Electromagnetic Compatibility

Standard	Test Method	Description	Test Levels
EN 55024	EN 61000-4-2	Electrostatic Discharge	6 kV contact & 8 kV air
EN 55024	EN 61000-4-3	Radiated Immunity	10 V/m, 80 MHz to 1 GHz
EN 55024	EN 61000-4-4	Fast Transient Burst	1 kV clamp & 2 kV direct
EN 55024	EN 61000-4-5	Voltage Surge	2 kV L-L & 2 kV L-Earth
EN 55024	EN 61000-4-6	Conducted Immunity	10 Volts (rms)
EN 55024	EN 61000-4-11	Voltage Dips & Interruptions	1 Line Cycle, 1 to 5 s @ 100% dip
EN 55022	CISPR 22	Radiated Emissions	Class A
EN 55022	CISPR 22	Conducted Emissions	Class B
CFR 47, Part 15	ANSI C63-4	Radiated Emissions	Class A

## Ordering Information

Model	Description
BASR-8M	BAS Remote Master with 8 I/O points
BASR-8X	BAS Remote Expansion with 8 I/O points
BASR-8M/P	BAS Remote Master with 8 I/O points and PoE

### United States

Contemporary Control Systems, Inc.  
2431 Curtiss Street  
Downers Grove, IL 60515  
USA

Tel: +1 630 963 7070  
Fax: +1 630 963 0109

[info@ccontrols.com](mailto:info@ccontrols.com)  
[www.ccontrols.com](http://www.ccontrols.com)

### China

Contemporary Controls (Suzhou) Co. Ltd  
11 Huoju Road  
Science & Technology Industrial Park  
New District, Suzhou  
PR China 215009

Tel: +86 512 68095866  
Fax: +86 512 68093760

[info@ccontrols.com.cn](mailto:info@ccontrols.com.cn)  
[www.ccontrols.asia](http://www.ccontrols.asia)

### United Kingdom

Contemporary Controls Ltd  
14 Bow Court  
Fletchworth Gate  
Coventry CV5 6SP  
United Kingdom

Tel: +44 (0)24 7641 3786  
Fax: +44 (0)24 7641 3923

[info@ccontrols.co.uk](mailto:info@ccontrols.co.uk)  
[www.ccontrols.eu](http://www.ccontrols.eu)

### Germany

Contemporary Controls GmbH  
Fuggerstraße 1 B  
04158 Leipzig  
Germany

Tel: +49 341 520359 0  
Fax: +49 341 520359 16

[info@ccontrols.de](mailto:info@ccontrols.de)  
[www.ccontrols.eu](http://www.ccontrols.eu)