
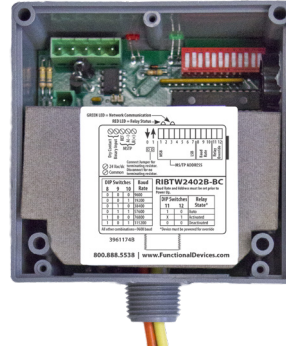


INTELLIGENT FIELD DEVICE

RIBTW2402B-BC

BACnet MS/TP Network Relay Device, One Binary Output + Override, One Binary Input, 24Vac/dc/208-277Vac Power Input, NEMA 1 Housing

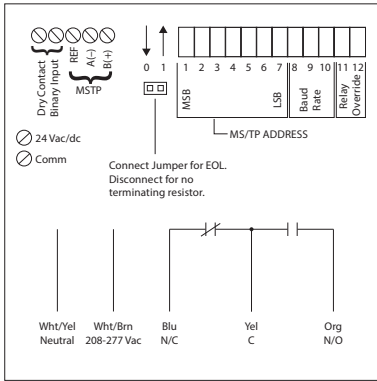

SPECIFICATIONS

- # Relays & Contact Type:** One (1) SPDT Continuous Duty Coil
- Expected Relay Life:** 10 million cycles minimum mechanical
- Operating Temperature:** -30 to 140° F
- Humidity Range:** 5 to 95% (noncondensing)
- Operate Time:** 18ms
- Green LED:** Network Communication
- Red LED:** Relay Status
- Dimensions:** 4.00"H x 4.00"W x 1.81"D with 0.50" NPT nipple
- Housing Detail:** See **Housing C** in housing guide for dimensions
- Origin:** Made of US and non-US parts
- Wires:** 16', 600V Rated
- Approvals:** CE, UL Listed, UL916, C-UL, RoHS
- Housing Rating:** UL Accepted for Use in Plenum, NEMA 1
- Gold Flash:** No
- Relay Override Switch:** DIP Switch Control
- Network Media:** Twisted Pair 22-24AWG, shielded recommended
- Terminations:** Functional Devices product installed at both ends of the MS/TP network – Use 120 Ω end of line resistors. All other cases – Follow instructions from the device installed at the end of the MS/TP network.
- Polarity:** Network is polarity sensitive
- Baud Rate:** 9600, 19200, 38400, 57600, 76800, 115200 (DIP Switch Selectable)

- Contact Ratings:**
 - 20 Amp Resistive @ 277 Vac
 - 20 Amp Ballast @ 277 Vac
 - 16 Amp Electronic Ballast @ 277 Vac (N/O)
 - 10 Amp Tungsten @ 120 Vac (N/O)
 - 1110 VA Pilot Duty @ 277 Vac
 - 770 VA Pilot Duty @ 120 Vac
 - 2 HP @ 277 Vac
 - 1 HP @ 120 Vac
- Power Input Ratings:**
 - 81 mA @ 24 Vdc
 - 111 mA @ 24 Vac
 - 121 mA @ 208-277 Vac

- Power Input:** 24 Vac/dc ; 208-277 Vac ; 50/60 Hz

- Notes:**
 - When connecting 24 Vac to both the RIB(s) and a half-wave device, damage to device can occur.
 - Option 1: Use separate transformers for each device.
 - Option 2: Add diode between devices, see Option 2 note below. ^^

- BACnet® Details:**
 - MS/TP Address & Baud Rate must be set prior to power up via DIP switches.
 - Device ID will default to 277XXX where XXX is the MS/TP Address.

MS/TP Address - 004
Device ID - 277004

MS/TP Address - 121
Device ID - 277121

- Device ID can be changed via network command. Once changed, it will no longer default to 277XXX. (MS/TP Address & Device ID must be unique.)
- This model utilizes: BO 1 (Relay output), BI 1 (Dry contact binary input).
- Device Instance changed via Object Identifier Property of Device Object
- PIC Statement available on website.


| DIP SWITCHES* | | | BAUD RATE |
|---------------|---|----|-----------|
| 8 | 9 | 10 | |
| 0 | 0 | 0 | 9600 |
| 0 | 0 | 1 | 19200 |
| 0 | 1 | 0 | 38400 |
| 0 | 1 | 1 | 57600 |
| 1 | 0 | 0 | 76800 |
| 1 | 0 | 1 | 115200 |

All other combinations=9600 baud

| DIP SWITCHES* | | RELAY STATE** |
|---------------|----|---------------|
| 11 | 12 | |
| 1 | 0 | Auto |
| X | 1 | Override on |
| 0 | 0 | Override off |

* 0 = Open ; 1 = Closed

** Device must be powered for override

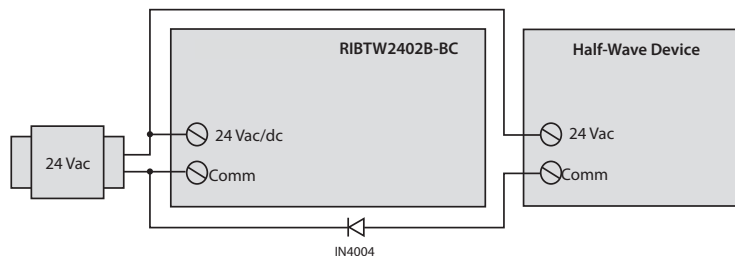

^^ Option 2: Add diode on 24 Vac power (Comm) interconnection between devices. Band on diode faces towards RIB(s).

- Dry contact binary input is a general purpose input that is not tied to the relay internally. Can be used with any dry contact switching device, such as a current sensor, to report back to the network.