

Condensation Sensor

For detection of condensation on chilled surfaces (e.g. chilled beams). With signal LED and relay contact for connection to controller and display systems or for series connection with the cooling valve to interrupt the cold water flow directly when condensation begins. NEMA 4X / IP65 rated enclosure.

Technical data sheet

22HH-500X





	Туре	Output signal condensation detector switch	Additional features	Cable length	
	22HH-500X	changeover	External sensor	6.5 ft. [2 m]	-
Technical Data					
Electrical Data	Power supply DC Power supply AC		1524 V, ±10%, 0.8 W		
			24 V, , ±10%, 1.6 VA		
	Electrical connection		Removable spring loaded terminal block max. 2.5 mm ²		
	Cable entry		Cable gland with strain relief Ø68 mm (1/2" NPT conduit adapter included)		
Functional Data	Output signal switch note Display		changeover contact, isolated max. switching current 1 A @ 24 V min. switching current 5 mA @ 10 V		
			LED,		
			green - power supply ok		
			red - dew permeation		
Macouring Data	Application		water condensation		
Measuring Data Materials	Measuring values		PA6, black		
iviale lais	Cable gland Housing				
			cover: lexan, orange base: lexan, orange		
			seal: 0467 NBR70, black		
			UV resistant		
Safety Data	Ambient humidity Ambient temperature Fluid temperature Protection class IEC/EN Protection class UL EU Conformity Certification IEC/EN Certification UL Degree of protection IEC/EN		max. 95% r.H., non-condensing		
			-5120°F [-2050°C]		
			-5140°F [-2060°C]		
			III safety extra-low voltage (selv)		
			UL Class 2 Supply		
			CE Marking		
			IEC/EN 60730-1		
			cULus acc. to UL60730-1A/-2-9/-2-13, CAN/ CSA E60730-1:02/-2-9		
			IP65		
	Quality Standa	rd	ISO 90	001	



Safety Notes



This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorised modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Remarks

General Remarks Concerning Sensors

Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of the transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage (± 0.2 V). When switching the supply voltage on/off, onsite power surges must be avoided.


Scope of delivery

Scope of delivery

ry Description	Туре
Mounting plate S housing	A-22D-A09
Syringe with thermal paste	A-22P-A44
Screws	
Dowel	
Cable tie	
1/2" NPT conduit adapter	



Wiring Diagram

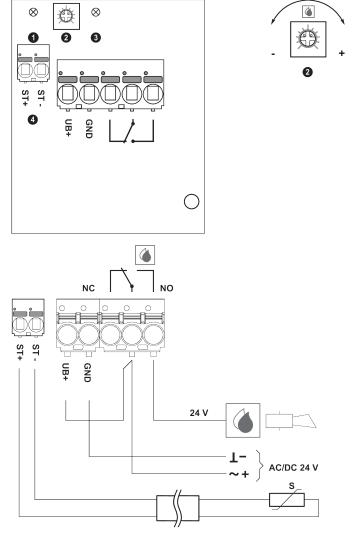

① LED red: dew permeation
 ② Sensitivity adjustment

 less sensible
 more sensible
 ③ LED green: power supply OK
 ④ For external condensation sensor



Dimensions



